Inverter User Manual



Table Of Contents

1.Information on this Manual 01
- 1.1 Validity 01
- 1.2 Scope 01
- 1.3 Target Group 01
- 1.4 Label Description 01
- 1.5 Safety Instructions 02

2.Introduction 03

3. Installation 04
- 3.1 Unpacking and Inspection 04
  - 3.1.1 Open-box Inspection 04
  - 3.1.2 Installation Tools 04
- 3.2 Mounting Unit 05
- 3.3 AC Input / Output Connection 07
- 3.4 PV Connection 10
- 3.5 Battery Connection 12
  - 3.5.1 Lead-acid Battery Connection 12
  - 3.5.2 Lithium Battery Connection 14
- 3.6 Final Assembly 15
- 3.7 Smart Communication Stick Connection(Optional) 15

4. Operation 16
- 4.1 Power ON/OFF 16
- 4.2 Operation and Display Panel 16
  - 4.2.1 LCD Display Icons 18
  - 4.2.2 LCD Setting 21
- 4.3 Display Information 32

5. Fault Reference Code 34

6. Alarm Reference Code 37

7. Battery Equalization 39

8. Trouble Shooting 40

9.Specifications **42**

1.Information on this Manual

1.1 Validity

This manual is valid for the following devices:

- 5000W inverter

1.2 Scope

This manual describes the assembly, installation, operation and of this unit. Please read this manual carefully before installations and operations.

1.3 Target Group

This document is intended for qualified persons and end users. Tasks that do not require any particular qualification can also be performed by end users. Qualified persons must have the following skills:

- Knowledge of how an inverter works and is operated
- Training in how to deal with the dangers and risks associated with installing and using electrical devices and installations
- Training in the installation and commissioning of electrical devices and installations
- Knowledge of the applicable standards and directives
- Knowledge of the compliance with this document and all safety information

1.4 Label Description

In order to ensure the user's personal safety when using this product, the inverter and manual provides relevant identification information and uses appropriate symbols to alert the user, who should carefully read the following list of symbols used in this manual.

Labels on Inverter

	CAUTION Do not disconnect under load!
	Danger: High Voltage! Danger: Electrical Hazard!
	Start maintaining the INVERTER at least 5 minutes after the INVERTER disconnected from all external power supplies.
	Read instructions carefully before performing any operation on the INVERTER.
	Grounding: The system must be firmly grounded for operator safety.

Labels in the documentation

⚠ WARNING!	A high level of potential danger, which, if not avoided, could result in death or serious injury to personnel.
⚠ CAUTION!	A moderate or low level of potential danger, which, if not avoided, could result in moderate or minor injuries to personnel. In some bad situation, it could result in death or serious injury to personnel.

1.5 Safety Instructions



WARNING!


This chapter contains important safety and operating instructions.

Read and keep this manual for future reference.

01. Please be clear which kind of battery system you want, lithium battery system or lead-acid battery system, if you choose the wrong system, energy storage system can't work normally.
02. Before using the unit, read all instructions and cautionary marking on the unit, the batteries and all appropriate sections of this manual. The company has the right not to quality assurance, if not according to the instructions of this manual for installation and cause equipment damage.
03. All the operation and connection please professional electrical or mechanical engineer.
04. All the electrical installation must comply with the local electrical safety standards.
05. When install PV modules in the daytime, installer should cover the PV modules by opaque materials, otherwise it will be dangerous as high terminal voltage of modules in the sunshine.
06. CAUTION – To reduce risk of injury, charge only deep-cycle lead-acid type rechargeable batteries and lithium batteries. Other types of batteries may burst, causing personal injury and damage.
07. Do not disassemble the unit. Take it to a qualified service center when service or repair is required. Incorrect re-assembly may result in a risk of electric shock or fire.
08. To reduce risk of electric shock, disconnect all wirings before attempting any maintenance or cleaning.Turning off the unit will not reduce this risk.
09. NEVER charge a frozen battery.
10. For optimum operation of this inverter, please follow required spec to select appropriate cable size. It's very important to correctly operate this inverter.

11. Be very cautious when working with metal tools on or around batteries. A potential risk exists to drop a tool to spark or short circuit batteries or other electrical parts and could cause an explosion.
12. Please strictly follow installation procedure when you want to disconnect AC or DC terminals. Please refer to INSTALLATION section of this manual for the details.
13. GROUNDING INSTRUCTIONS –This inverter should be connected to a permanent grounded wiring system. Be sure to comply with local requirements and regulation to install this inverter.
14. NEVER cause AC output and DC input short circuited. Do NOT connect to the grid when DC input short circuits.
15. Make sure the inverter is completely assembled, before the operation.

2.Introduction

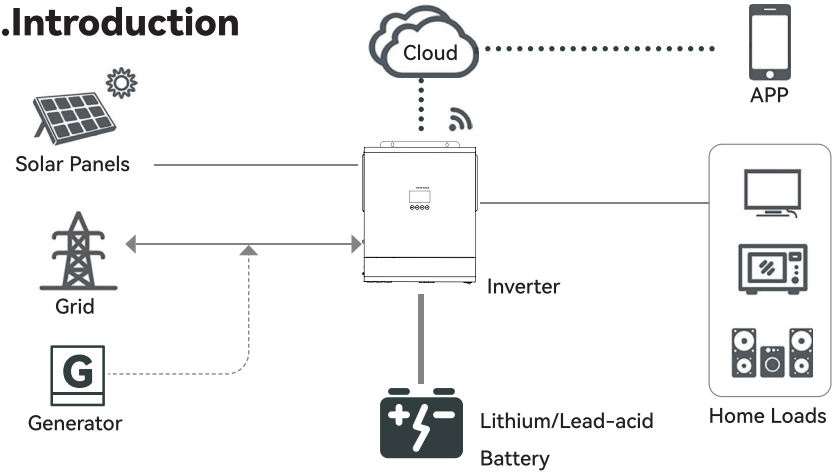

Solar Energy Storage System

This is a multifunctional solar inverter, integrated with a MPPT solar charge controller, a high frequency pure sine wave inverter and a UPS function module in one machine, which is perfect for off grid backup power and self-consumption applications. This inverter can work with or without batteries.

The whole system also need other devices to achieve complete running such as PV modules, generator, or utility grid. Please consult with your system integrator for other possible system architectures depending on your requirements. The WiFi module is built-in or plug-and-play monitoring device to be installed on the inverter. With this device, users can monitor the status of the PV system from the mobile phone or from the website anytime anywhere.




3. Installation

3.1 Unpacking and Inspection

3.1.1 Open-box Inspection

Products have been strictly tested before leaving the factory. Please sign for them after inspection. If the product is damaged, please contact the local distributor. Please open the box to check whether the outer packaging is intact or damaged, whether the internal equipment is damaged.


3.1.2 Installation Tools

Installation Tools	Multi-meter 	Protective gloves 	Insulated anti-smashing shoes 
	Safety glasses 	ESD wrist strap 	Hammer drill 
	Electric screwdriver 	Cross screwdriver 	Rubber mallet 
	Spirit level 	Wire cutter / stripper 	Terminal crimping tool 

3.2 Mounting Unit

Consider the following points before selecting where to install:

- Do not mount the inverter on flammable construction materials.
- Mount on a solid surface.
- Install this inverter at eye level in order to allow the LCD display to be read at all times.
- The ambient temperature should be between -10℃ and 60℃ to ensure optimal operation.
- The recommended installation position is to be adhered to the wall vertically.
- Be sure to keep other objects and surfaces as shown in the diagram above to guarantee sufficient heat dissipation and to have enough space for removing wires.

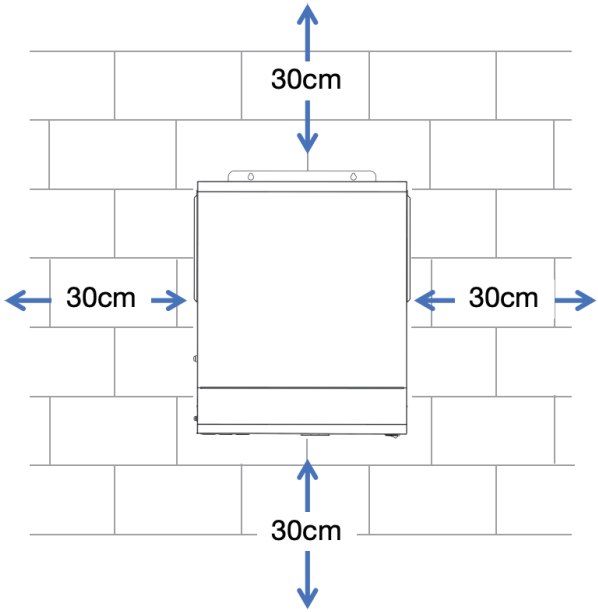


WARNING!

Inverter is suitable for mounting on concrete or other non-combustible surface only.


Follow the installation steps:

1. Use ϕ8 drilling bit drill holes on the mounting surface. The distance between 2 holes is 160mm. Then insert the expansion screw tube. M6 expansion screw is suggested.

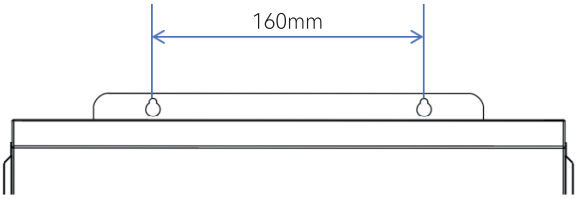

2. Pick up the inverter vertically and align the screws' holes at the top of the inverter with the expansion screw tube already installed on the wall. Fix the inverter on the mounting surface by screws.

Before connecting all wiring, please take off bottom cover by removing four screws as shown below:

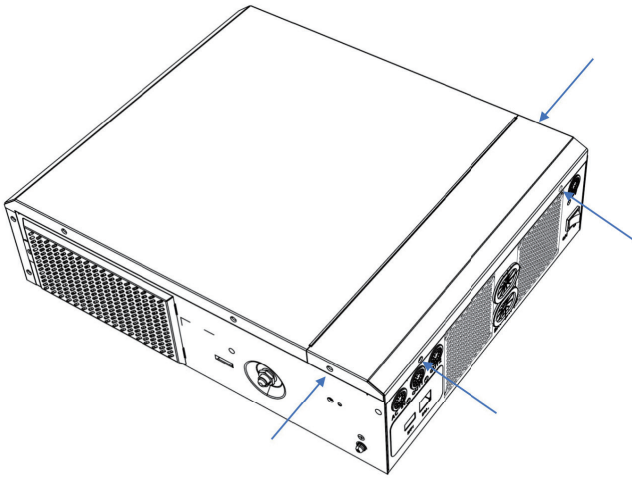

3.3 AC Input / Output Connection



CAUTION!

Before connecting to AC input power source, please install a separate AC breaker between inverter and AC input power source. This will ensure the inverter can be securely disconnected during maintenance and fully protected from over current of AC input. The recommended spec of AC breaker is 40A.



CAUTION!

There are three terminal blocks with 'AC IN', 'AC OUT1', 'AC OUT2' markings. Please do NOT mis-connect input and output connectors.



CAUTION!

Be sure to connect AC cables with correct polarity. If L and N wires are connected reversely, it may cause utility short-circuited when these inverters are worked in parallel operation



WARNING!

All wiring must be performed by a qualified personnel.



WARNING!

It's very important for system safety and efficient operation to use appropriate cable for AC input connection. To reduce risk of injury, please use the proper recommended cable size as below.

Suggestion for AC input wires

Gauge	Cable (mm^2)
10 AWG	5.26



WARNING!

It's very important for system safety and efficient operation to use appropriate cable for AC output 1/2 connection. To reduce risk of injury, please use the proper recommended cable size as below.

Suggestion for AC output wires

Gauge	Cable (mm^2)
12 AWG	4


WARNING!

Make sure AC power is disconnected before attempting to connect AC power to the unit.


All operations during the electrical connection process, as well as the specifications of cables and components used, must comply with local laws and regulations. The cable color mentioned below is for typical reference.


Please follow below steps to implement AC input (AC IN) connection:

1. Before making AC connection, be sure to open AC circuit breaker first.
2. Remove insulation sleeve 12mm from the head of cables, shorten the conductor part to 10mm. Insert the cable into the tubular terminal. Then use terminal crimping tool make the terminal and cable connected tightly.

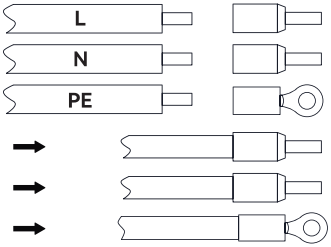

3. Insert AC input cables according to polarities indicated on terminal blocks and tighten the terminal screws. Be sure to connect PE protective cable on the inverter side first.
   PE → Protective Earth (yellow-green)
   L → LINE (brown or black)
   N → Neutral (blue)

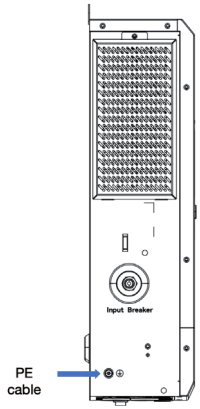


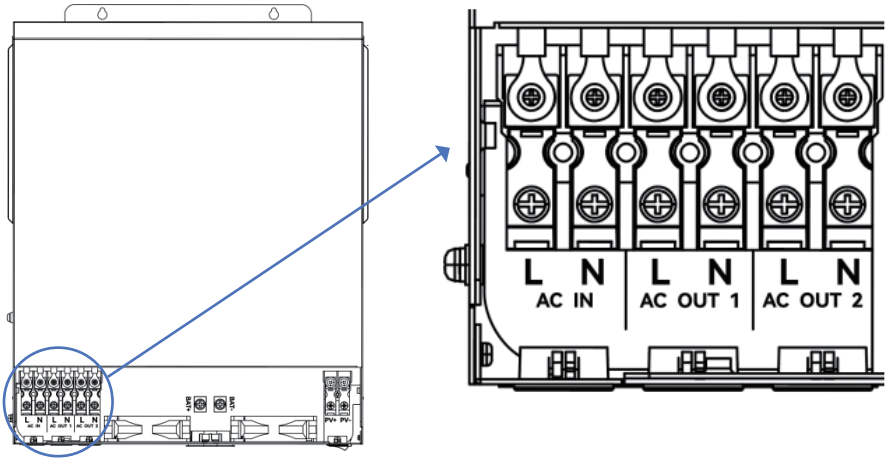

4. Make sure the cables are securely connected.

To implement AC output (OUT1/OU2) connection:

Follow the steps as AC input connection of L (LINE) and N (Neutral) cables.



CAUTION!

Appliances such as air conditioner are required at least 2~3 minutes to restart because it's required to have enough time to balance refrigerant gas inside of circuits. If a power shortage occurs and recovers in a short time, it will cause damage to your connected appliances. To prevent this kind of damage, please check with manufacturer of air conditioner that if it's equipped with time-delay function before installation. Otherwise, this solar inverter will trig overload fault and cut off output to protect your appliance but sometimes it still causes internal damage to the air conditioner.

3.4 PV Connection

CAUTION!
Before connecting to PV modules, please install a separate DC circuit breaker between inverter and PV modules.

WARNING!
Do not ground the positive or negative terminals of the PV modules, as this can severely damage the inverter.

WARNING!
Exposure to sunlight can generate lethal high voltages in photovoltaic strings, so strictly adhere to the safety precautions listed in the photovoltaic string and related documents.

WARNING!
Make sure to connect the PV terminals to the corresponding ports on the inverter, as reversing the polarity can damage the inverter.

WARNING!
All wiring must be performed by a qualified personnel.

WARNING!
It's very important for system safety and efficient operation to use appropriate cable for PV module connection. To reduce risk of injury, please use the proper recommended cable size as below. The cable color mentioned below is for typical reference.

Gauge	Cable (mm^2)
10AWG	5.26

PV Module Selection:

When selecting proper PV modules, please be sure to consider below parameters:


1. Open circuit Voltage (Voc) of PV modules not exceeds max. PV array open circuit voltage of inverter.
2. Open circuit Voltage (Voc) of PV modules should be higher than start-up voltage.

Max. PV Array Open Circuit Voltage	500Vdc
Start-up Voltage	80Vdc
PV Array MPPT Voltage Range	60Vdc~450Vdc

WARNING!
Please do not connect any DC switches or AC/DC circuit breakers before completing the electrical connections.

Please follow below steps to implement PV module connection:


1. Before making PV connection, be sure to open DC circuit breaker first.
2. Remove insulation sleeve 12mm from the head of cables, shorten the conductor part to 10 mm. Insert the cable into the tubular terminal. Then use terminal crimping tool make the terminal and cable connected tightly

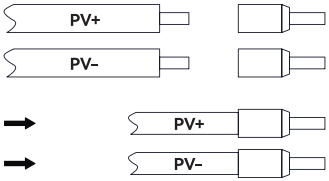

3. Use multi-meter check to ensure the polarities are correct.
4. Insert PV cables according to polarities indicated on terminal block and tighten the terminal screws.

+ → PV+ (red)

- → PV- (black)

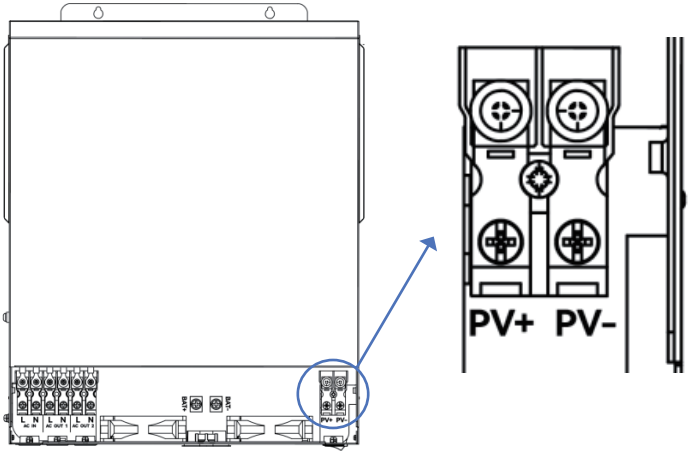

5. Make sure the cables are securely connected.

3.5 Battery Connection

3.5.1 Lead-acid Battery Connection

User can choose proper capacity lead acid battery with a nominal voltage at 24V. Also you need to choose battery type as 'AGM or FLD(flooded)'.



CAUTION!

For safety operation and regulation compliance, it's requested to install a separate DC over-current protector or disconnect device between battery and inverter. It may not be requested to have a disconnect device in some applications, however, it's still requested to have over-current protection installed. The recommended size of protector or disconnect is 250A.



WARNING!

All wiring must be performed by a qualified person.



WARNING!

It's very important for system safety and efficient operation to use appropriate cable for battery connection. To reduce risk of injury, please use the proper recommended cable and terminal size as below. The cable color mentioned below is for typical reference.



WARNING!

Make sure AC power is disconnected before attempting to connect AC power to the unit.

All operations during the electrical connection process, as well as the specifications of cables and components used, must comply with local laws and regulations.The cable color mentioned below is for typical reference.


Recommended battery cable and terminal size:

Gauge	Cable (mm^2)
1 AWG	42


Note: For lead acid battery, the recommended charge current is 0.3C (C≤battery capacity)

Please follow below steps to implement battery connection:

1. Unscrew the pre-fixed screws on battery poles. Prepare 2 DT terminals(It should fit for AWG1 cables).
2. Remove insulation sleeve 12mm from the head of cables, shorten the conductor part to 10 mm. Insert the cable into the DT terminal. Then use terminal crimping tool make the terminal and cable connected tightly.



3. Pass the battery cable through the battery installation hole on bottom shell, and tighten the terminal screws. Make sure polarity at both the battery and the inverter/charge is correctly connected and DT terminals are tightly screwed to the battery terminals.

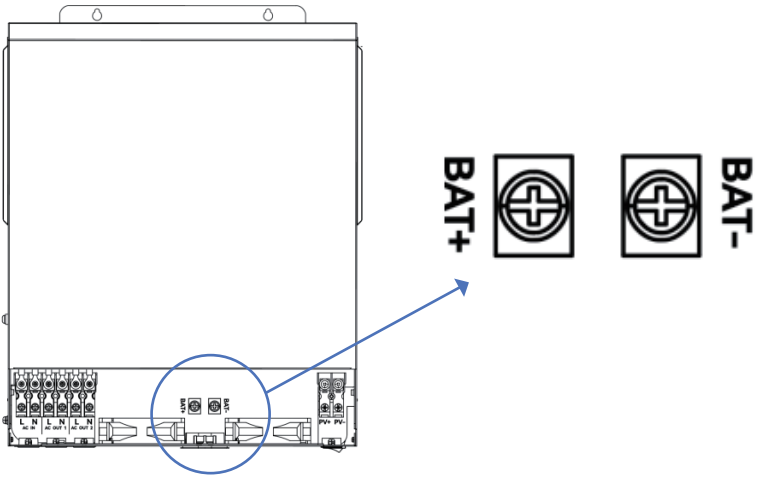

4. Connect all battery packs as units requires. It's suggested to connect at least 200Ah capacity battery.

WARNING! Shock Hazard

Installation must be performed with care due to high battery voltage in series.

CAUTION!

Do not place anything between the flat part of the inverter terminal and the DT terminal. Otherwise, overheating may occur.

CAUTION!

Do not apply anti-oxidant substance on the terminals before terminals are connected tightly.

CAUTION!


Before making the final DC connection or closing DC breaker/disconnector, be sure positive (+) must be connected to positive (+) and negative (-) must be connected to negative (-).

3.5.2 Lithium Battery Connection

If choosing lithium battery for inverter, Please check the compatibility of the protocol first. There are two connectors on the lithium battery, RJ45 port of BMS and power cable.

Please follow below steps to implement lithium battery connection:

1. Follow section 3.5.1 to implement the power cable connection.
2. Connect RJ45 terminal of battery communication cable to BMS communication port of inverter. The communication protocol should be RS485 or CAN.

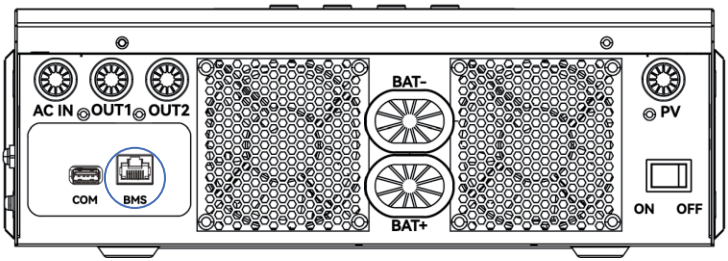

3. Insert the other end of RJ45 (battery communication cable) to battery communication port of lithium battery.

Note: If choosing lithium battery, make sure to connect the BMS communication cable between the battery and the inverter.

Lithium battery communication and setting:

In order to communicate with battery BMS, you should set the battery type to 'LIT' or 'FEL' in Section 4.2.2 Program 17.

Make sure the lithium battery BMS port connects to the inverter is Pin to Pin, the inverter BMS port pin assignment shown as below:

Pin number	BMS port
1	RS485B
2	RS485A
3	-
4	CANH
5	CANL
6	-
7	-
8	-

Communicating with battery BMS in parallel system

If need to use communicate with BMS in a parallel system, you should make sure to connect the BMS communication cable between the battery and one inverter of the parallel system.


3.6 Final Assembly

After connecting all wiring, please put bottom cover back by screwing four screws mentioned in Section 3.2.

3.7 Smart Communication Stick Connection(Optional)

The smart communication stick (WIFI) is used to connect to the cloud platform. Please insert the stick into COM port directly.


Some models support built-in WIFI monitoring function, please check the solar APP quick configuration guide.

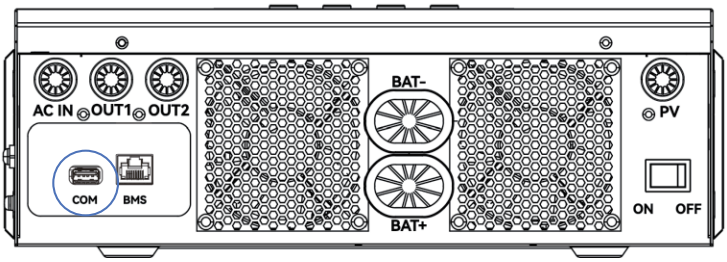

4. Operation


4.1 Power ON/OFF

Once the unit has been properly installed and the batteries are connected well, simply press ON/OFF switch (located on the button of the case) to turn on the unit.

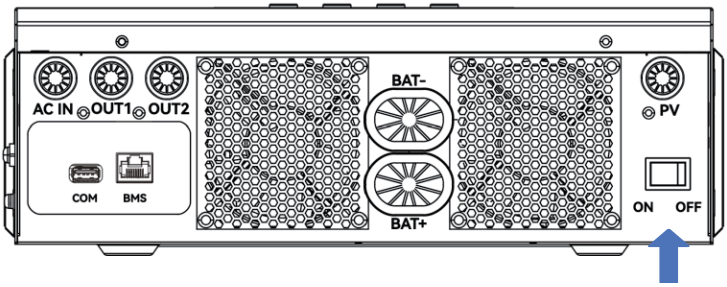


4.2 Operation and Display Panel

The operation and display panel, shown in below chart, is on the front panel of the inverter. It includes four indicators, four function keys and a LCD display, indicating the operating status and input/output power information.




LED Indicator			Messages
① AC	Status indicator (Green)	Solid On	The grid power is normal and enters the grid power operation.
		Flashing	The grid power is normal, but it has not entered grid power operation.
		Off	The grid power is abnormal.
② Inverter	Invert indicator (Yellow)	Solid On	Output is powered by battery or PV in battery mode.
		Off	Other states.
③ Charging	Charging indicator (Yellow)	Solid On	The battery is in float charging.
		Flashing	The battery is in constant voltage/constant current charging.
		Off	Other states.
④ Fault	Fault indicator (Red)	Solid On	Fault occurs in the inverter.
		Flashing	Warning condition occurs in the inverter.
		Off	The inverter is working properly.

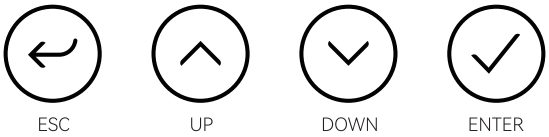


Function Buttons

Button	Description
ESC	To exit setting mode
UP	To go to previous selection
DOWN	To go to next selection
ENTER	To confirm the selection in setting mode or enter setting mode

4.2.1 LCD Display Icons

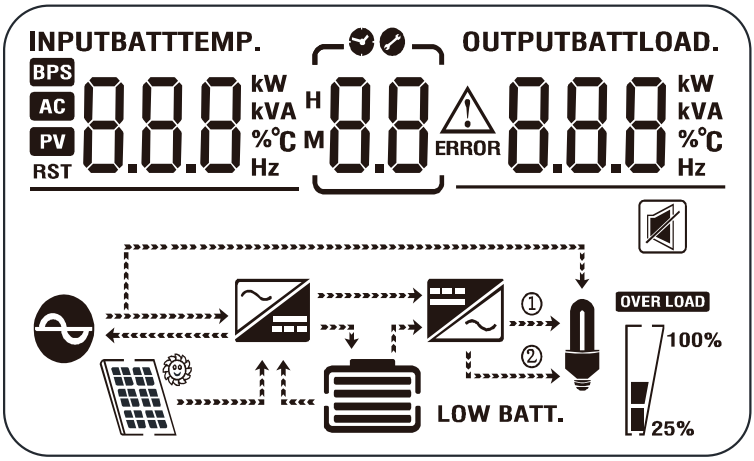

Icon	Description
AC Input Information	
	AC input icon.
	Indicate AC input power, AC input voltage, AC input frequency, AC input current.
PV Input Information	
	PV input icon.
	Indicate PV power, PV voltage, PV current, etc.
Output Information	
	Inverter icon.
	Indicate output voltage, output current, output frequency, inverter temperature.
	Dual output (output1 and output2)
Load Information	
	Load icon.
	Indicate power of load, power percentage of load.
	Indicate overload happened.
Battery Information	
	Indicate battery level by 0-24%, 25-49%, 50-74% and 75-100% in battery mode and charging status in line mode.
	Indicate battery voltage, battery percentage, battery current.
Other Information	
	Indicate alarm code or fault code.
	Indicate a fault is happening.
	Indicate the alarm is disabled.

For Lead-acid battery, detailed description of battery icon as following:

In battery mode, battery icon will present Battery Capacity		
Load Percentage	Battery Voltage	Display
Load >50%	< 22.292V	
	22.292V ~ 23.37V	
	23.37V ~ 24.448V	
	> 24.448V	
50%> Load > 20%	< 23.59V	
	23.59V ~ 24.668V	
	24.668V ~ 25.746V	
	> 25.746V	
Load < 20%	< 24.24V	
	24.24V ~ 25.318V	
	25.318V ~ 26.395V	
	> 26.395V	



4.2.2 LCD Setting

After pressing and holding ENTER button for 2 seconds, the unit will enter setting mode. Press 'UP' or 'DOWN' button to select setting programs. Then press 'ENTER' button to confirm the selection or ESC button to exit.

Program	Description	Setting Option	
01	Output voltage		
		230V (default) Adjustable/settable value: 208V, 220V, 230V, 240V	
02	Output frequency		
		50Hz(default) Adjustable/settable frequency: 50Hz, 60Hz	
03	Output source priority	Grid first (default)	
		Grid provides power to the loads as first priority. Solar power will charge the battery. If solar is not sufficient to charge battery, grid will charge the battery at the same time. If grid is absent and solar is sufficient, solar will power the loads. If grid is absent and solar is not sufficient, solar and battery will power the loads. If grid is absent, solar and battery are not sufficient to power loads at the same time, inverter will go to standby and charge battery.	
		Solar first	
		Solar energy provides power to the loads as first priority. If solar energy is sufficient, battery will be charged with solar energy. If solar energy is not sufficient to power all connected loads, Grid will supply power to the loads at the same time. If grid is absent and solar is not sufficient, solar and battery will power the loads. If grid is absent, solar and battery are not sufficient to power loads at the same time, inverter will go to standby and charge battery.	

03	Output source priority	PBG priority	
		Solar energy provides power to the loads as first priority. If solar energy is sufficient, solar will charge the battery. If solar energy is not sufficient, battery will also supply power. If solar and battery energy are not sufficient, grid will supply power to the loads and solar charges the battery. If battery is charged to be sufficient, solar and battery will power the loads instead of grid. If grid is absent, solar and battery are not sufficient to power loads at the same time, inverter will go to standby and charge battery.	
		MKS	
		Generator provides power to loads as first priority. When generator, PV, battery all exist, the work mode is as PBG. When generator and battery exist (no PV), the work mode is as GPB. When generator and PV exist (no battery), the work mode is as GPB.	
04	Input mode	APP: Appliance (default)	
		Applied to household appliances Typical switching time is 10ms.	
		UPS	
		Applied to computer and other devices. Typical switching time is 10ms.	
		GEN	
		Applied to connect generator from AC IN port. Typically switching time is 20ms.	
05	Charger source priority	PNG: PV and Grid (default)	
		PV and Grid are charged at the same time.	
		OPV: Only PV	
		Only PV charge.	
		PVF: PV first	
		If both gird and PV are available, PV charge. If only PV is available, PV charge. If only grid is available, grid charge.	

06	Grid charging current		
		The default setting is 80A. Available options: 2/10/20/30/40/50/60/70/80/90/100/110/120/130/140/150/160A	
07	Maximum charging current		
		Set total charging current for solar and grid chargers. The default setting is 120A. Available options: 2/10/20/30/40/50/60/70/80/90/100/110/120/130/140/150/160A	
08	Menu Default		
		During setting: Set to ON. If the current page is not on the first page and no operation with 1 minute, the system will return to display the first page. Set to OFF. If the current page is not on the first page and no operation with 1 minute, the system will stay on the current page.	
09	Auto restart when overload occurs	ON(default)	
10	Auto restart when over temperature occurs	ON(default)	
11	Main input cut warning		
		Enable/Disable Grid or PV loss alarm. The default setting is ON. If the grid/PV input detected lost, the buzzer will sound for 5 seconds. when set to OFF, after the grid/PV input is lost, the buzzer will not sound.	
12	Energy-saving mode		
		The default setting is OFF. When set to ON, in battery mode, if the load is lower than 25W, the system will stop output for a period then resume. If the load is still lower than 25W, the system will do the loop stop then resume. If the load is higher than 35W, the system will resume continuous normal output.	
13	Overload transfer to bypass		
		The default setting is OFF. When set to ON, in the case of PBG (PV priority) or MKS (generator priority) mode, if there is an overload, the system will immediately transfer to bypass mode (grid power output, also known as bypass mode).	

14	Silent mode setting		
		Enable/disable buzzer sound. The default setting is OFF. When set to ON, in any situation such as alarms or faults, the buzzer will not sound. This setting can be applied to all modes. Button sound is not effected.	
15	Battery return to grid voltage point		
		When the battery is set to the AGM (Lead Acid Battery Type) or FLD (Flooded Battery Type) mode. The default setting is 23V, and it can be adjusted within a range of [22, 26V].	
		When the battery is set to LIT (Ternary lithium battery). The default setting is 23.8V. It can be adjusted within a range of [20, 25V]. When the battery is set to FEL (Lithium iron battery), the default setting is 24.8V. It can be adjusted within a range of [20, 25V].	
		When the battery is set to the CUS (Customer Setting Type) mode. The default setting is 23.8V, and it can be adjusted within a range of [20, 25V].	
16	Switching back to battery mode voltage points		
		After the battery shuts down due to low voltage, it needs to reach a certain voltage level to restart in battery mode. The value can be set to FUL or battery voltage. If set to FUL, the battery will only recharge to full capacity before it can restart in battery mode.	
		When the battery is set to AGM (Absorbent Glass Mat) or FLD (Flooded) mode,The default setting is 26V. It can be adjusted within a range of [24, 29V].	
		When the battery is set to LIT (Ternary lithium battery) or CUS (Customer Set Type) mode. The default setting is 27.2V. It can be adjusted within a range of [23, 29V]. When the battery is set to FEL (Lithium iron battery), the default setting is 26.6V. It can be adjusted within a range of [23, 29V].	
17	Battery type	AGM(default)	
		Flooded	
		Lithium (Ternary Lithium Battery)	
		FEL (Lithium iron)	
		User-Defined	

18	Battery low voltage point	
		Battery low voltage alarm setting. When the battery type is set to LIT, the default setting is 23.8V. The adjustable range for the voltage is [20.6, 25V]. Initial settings for CUS are the same as for LIT. When the battery type is set to FEL, the default setting is 24V. The adjustable range for the voltage is [20.6, 25V].
		The voltage cannot be set if battery is AGM or FLD. The default setting is 22V.
19	Battery shutdown voltage point	
		The battery low voltage shutdown point setting function cannot be adjusted when the battery is defined as AGM or FLD mode. The default setting is 21V.
		When the battery type is set to LIT , the battery shutdown point can be modified. The default setting is 23V, and the adjustable range is [20, 24V]. Initial settings for CUS are the same as for LIT. When the battery type is set to FEL , the battery shutdown point can be modified. The default setting is 21V, and the adjustable range is [20, 24V].
20	Constant voltage mode voltage point setting	
		When the battery is defined in AGM or FLD mode, the voltage set point cannot be configured. The default setting for AGM mode is 28.2V, for FLD mode is 29V. When the battery type is CUS, It can be set within the range of [24, 30V] for the constant voltage charging set point. The default setting is 28.2V. It is important to note that the constant voltage set point voltage needs to be higher than the float charge set point voltage.
		When the battery type is set to LIT, the default setting is 28.2V, and it can be adjusted within the range of [24, 30V]. When the battery type is set to FEL, the default setting is 27.6V, and it can be adjusted within the range of [24, 30V]. It is important to ensure that the constant voltage set point voltage is higher than the float charge set point voltage.

21	Floating charge mode voltage point setting	 If battery type is AGM or FLD mode, the voltage set point cannot be configured. The default setting is 27V. If the battery type is CUS, the default setting is 27.6V. The setting range is [24, 30V]. If the battery type is LIT, the default setting is 27.6V. The setting range is [25, 30V]. If the battery type is FEL, the default setting is 27.2V. The setting range is [25, 30V]. It is important to note that the constant voltage point voltage should always be set higher than the floating charge point voltage.
22	Grid low voltage point setting	 If intput mode is APP/GEN, Grid low voltage point can be set within a range of 90V to 154V. The default setting is 154V. If intput mode is UPS, Grid low voltage point can be set within a range of 170V to 200V. The default setting is 185V.
23	Grid high voltage point setting	 If input mode is APP/GEN, Grid high voltage point can be set within a range of 264V to 280V. The default setting is 264V. If input mode is UPS, Grid high voltage point is set as 264V.
24	Automatic turn off backlight	 The default setting is ON. If ON, the backlight will turn off after 1minutes of no button operation.
25	Inverter soft start setting	 The default setting is OFF. If ON, the inverter output gradually increases from 0 to the target voltage value. If OFF, the inverter output directly increases from 0 to the target voltage value. Setting Condition: It can be set in single-machine operation mode.

26	Reset factory setting	 Restore all settings to factory default values. Before the setting, this interface is displayed as OFF. When set to ON, the system will restore to default settings. After the setting is completed, this interface will display OFF again. The setting can be applied immediately in grid and standby modes, but cannot be set in battery mode.
29	Battery Disconnection Alarm	 Enable/Disable battery disconnection alarm. OFF(default). When set to OFF, there will be no battery disconnection alarm when the battery is disconnected.
31	Equalization Voltage Point Setting	 The default setting for FEL battery type is 28V, setting range is [24, 30V]. The default setting for AGM/FLD/LIT/CUS battery type is 29.2V, with a configurable range of [24, 30V].
32	Equalization Charging Time Setting	 The function can be set as 'OFF' or active. During the equalization stage, the controller will charge the battery as much as possible until the battery voltage rises to the battery equalization voltage. Then, it will adopt constant voltage regulation to maintain the battery voltage. The battery will remain in the equalization stage until the set battery equalization time is reached. The setting range is [5, 900] with 5 minutes for every step. The default setting is OFF.

33	Equalization Delay Time Setting	 The function can be set as 'OFF' or active. During the equalization stage, if the battery equalization time expires and the battery voltage has not risen to the battery equalization voltage point, the charging controller will extend the battery equalization time until the battery voltage reaches the battery equalization voltage. When the battery equalization delay setting is completed and the battery voltage is still below the battery equalization voltage, the charging controller will stop equalization and return to the floating stage. The default setting is 120 minutes, with a configurable range of [5, 900], and an increment of 5 minutes for each setting.
34	Equalization Interval Time Setting	 When the battery connection is detected during the float phase with the equalization mode turned on, the controller will start to enter the equalization phase when the set equalization interval (cell equalization period)is reached.The default setting is 30 days, the settable range is[1,90], and the increment of each setting is 1 day.
35	Enable Equalization Immediately	 The default setting is OFF, and the function is not turned on. If it is set to ON, in the float charging stage when the equalization mode is turned on and the battery connection is detected. The equalization charging is activated immediately, and the controller will start to enter the equalization stage.

36	Grid-tie inverter function	 Set whether the inverter can feed to grid or not. If the value is 'INT', the inverter can feed to grid according to different output source priority. In PGB mode when battery level is sufficient, as long as grid is connected, PV can feed energy to grid as much as possible and surplus energy of PV charges the battery. In PGB mode when battery level is NOT sufficient, PV charges battery as much as possible and surplus energy of PV feeds to grid. In GPB mode and PBG mode, as long as grid is connected, PV charges battery as much as possible and surplus energy of PV feeds to grid. In MKS mode, inverter does not feed to grid.
37	Max Grid Tie Power	 Setting the output power value to grid. The default setting is 5.0kW. The setting range is [0, 5.0]kW. Every setting step is 0.5kW.
38	Battery dual output low voltage shutdown point	 When enabled, the secondary output of the inverter is enabled by default. In battery mode, when the battery voltage drops below the set point, the secondary output is turned off. When the battery voltage rises above the set value plus 1V per additional battery cell, the secondary output is turned on. The default setting is 24V, with a configurable range of [22, 30]V. When the set point is higher than the constant voltage charging (CV) point - 1V per cell, the recovery voltage is set to the constant voltage charging point.
39	Battery dual output duration	 When enabled, the secondary output of the inverter is enabled by default. In battery mode, when the battery discharge time reaches the set point, the secondary output is turned off. Default setting is OFF, the function is not enabled. The configurable range is [5,900] in minutes. When set to FUL, the secondary output has unlimited output time.


40	Dual output battery mode cut-off SOC	 When enabled, the secondary output of the inverter is enabled by default. In battery mode, when the battery SOC is lower than the set value, the secondary output is turned off. After the battery voltage is 5% higher than set value, the secondary output will turn on. The default setting is 20. The setting range is [5, 90] and OFF.
44	BMS Communication Function	 The default setting is OFF, and the function is not enabled. When set to a specific BMS protocol, the inverter communicates with the lithium battery BMS through the centralized control board and obtains battery information. If the communication is abnormal after the function is enabled, alarm 56 is generated, and the inverter does not determine the running logic based on the BMS information. CVT: CVTE protocol (485) PYL: PYLON protocol (485 and CAN) GRO: GROWATT protocol (485 and CAN) VOL: VOLTRONIC protocol (485) IRF: China Tower protocol (485) PAC: PACE RTU protocol (485)
45	BMS ID	 Setting BMS ID number to communication with. The setting value is AtO or numerical value [0, 15]. Among them, A-F represents 10-15 respectively. The default value is auto (AtO). When set to auto (AtO), system will automatically poll the BMS ID from small to large. When system poll for the first ID with a correct response, it locks the ID and only asks the BMS with that ID.

46	Low SOC Shutdown	 Set the inverter to shut down when the State of Charge (SOC) of the battery is low. The default setting is 20, with a configurable range of [5, 50]. When the lithium battery SOC reaches the set value in battery mode, the inverter shuts down and generates alarm 68. The alarm 68 is cleared when the SOC returns to the set value + 5%. In standby mode, the inverter can switch to battery mode only when the SOC reaches the set value + 10%. If it does not reach this threshold, alarm 69 is generated. Once the function is enabled, alarm 69 is triggered when the lithium battery SOC reaches the set value + 5%, and it is cleared when it returns to the set value + 10%. It can be set to OFF, in which case the inverter no longer performs shutdown, startup, or alarm operations based on the SOC condition. Once the function is enabled, if a communication abnormality occurs, the inverter no longer operates based on the SOC information and clears the related alarms.
47	High SOC to Battery	 Set the SOC value for the inverter to switch to battery mode. The default setting is 90, with a configurable range of [10, 100]. In PBG priority mode, when the lithium battery SOC reaches the set value in normal grid mode, the inverter switches to battery mode. Once enabled, the inverter will only switch to battery mode when the SOC is above the set point and the battery voltage is higher than the voltage point to switch back to battery mode. It can be set to OFF, in which case the inverter no longer switches from grid mode to battery mode based on the SOC condition. Once the function is enabled, if a communication abnormality occurs, the inverter no longer operates based on the SOC information and clears the related alarms.

48	Low SOC to Grid	
		Set the SOC value for the inverter to switch to grid mode. The default setting is 50, with a configurable range of [10, 90]. In PBG priority mode, when the lithium battery SOC reaches the set value in battery mode, the inverter switches to grid mode. Once enabled, the inverter will switch to grid mode when the SOC is below the set point or the battery voltage is lower than the voltage point to switch back to grid mode It can be set to OFF, in which case the inverter no longer switches from battery mode to grid mode based on the SOC condition. Once the function is enabled, if a communication abnormality occurs, the inverter no longer operates based on the SOC information and clears the related alarms. When this setting is higher than the STB point, STB and STG will no longer take effect after the next activation.
61	Battery Max. Discharge Current	
		The default setting is 190A. The inverter will not limit battery discharging current when set to OFF. When set to a numerical value, it indicates the limitation current value. The setting range is [10, 190A] with a setting step of 5A. If the discharging current is over the limitation, alarm 60 will occur. If the continuous over-current time reaches 5 seconds, fault 14 will occur and inverter goes into fault mode. If the value set to OFF, there are risks of overheating if the current exceeds of 190A for a long time.

4.3 Display Information

The LCD display information will be switched in turns by pressing 'UP' or 'DOWN' key. The selectable information is switched as below order: voltage, frequency, current, power, firmware version.

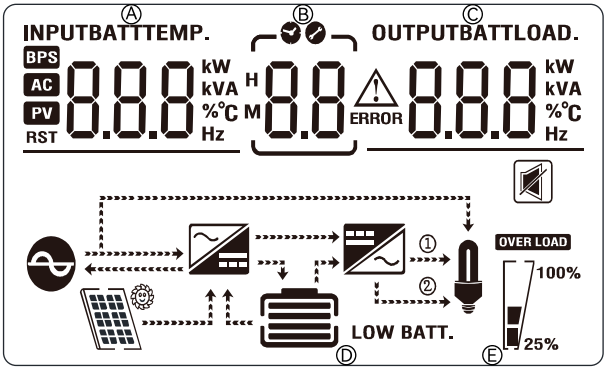


Ⓐ See table
Ⓑ Page number
Ⓒ See table
Ⓓ Battery capacity
Ⓔ Load percentage


After enabling BMS, Page 12/13/14/15/16/17 will be available.

The selectable information is switched as below.

LCD display	Informatiopn
	Ⓐ AC input voltage Ⓒ Output voltage
	Ⓐ AC input frequency Ⓒ Output frequency
	Ⓐ Battery voltage Ⓒ Charge current
	Ⓐ PV voltage Ⓒ PV charging current
	Ⓐ PV voltage Ⓒ PV power
	Ⓐ Output voltage Ⓒ Active power output
	Ⓐ Output voltage Ⓒ Apparent power output
	Ⓐ Output voltage Ⓒ Load percentage
	Diaplay software version
	Ⓐ Total power generation Ⓒ Daily power generation
	Parallel operation status
	Ⓐ Mode Ⓒ SIG(constant): battery pack is operating asa single group; PAR(constant): battery pack is operating in multiple groups in series and parallel; PAR(Flash): battery pack is establishing a state of multiple groups in series and parallelbattery
	Ⓐ Display battery voltage from BMS Ⓒ Display battery current from BMS. When BMS communication fails, both the upper left and upper right displays will flash ERR.
	Ⓐ Display batterry temperature from BMS Ⓒ Display battery SOC from BMS. When BMS communication fails, both the upper left and upper right displays will flash ERR.
	Ⓐ Display battery rated capacity Ⓒ Display battery current capacity. When BMS communication fails, both the upper left and upper right displays will flash ERR.

	Ⓐ Display the fixed letter CV Ⓒ Display the BMS constant voltage charging point. When BMS communication fails, the upper right display will flash ERR.
	Ⓐ Display BMS alarm information Ⓒ Display BMS fault information. When BMS communication fails, both the upper left and upper right displays will flash ERR.

5. Fault Reference Code

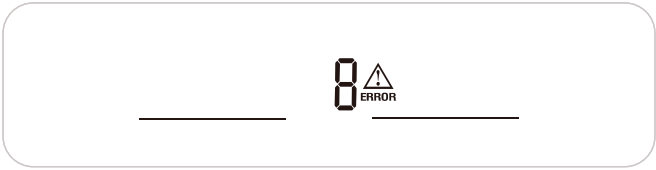

Fault display:

Function description: If alarm occurs, Fault indicator flashes and buzzer sounds every one second for 1 minute, then stop. If fault occurs, the fault indicator is always on, the buzzer sounds 10 seconds then stops. System will try restart aromatically. If the machine does not work after six times' restart, the machine and LCD display will always in the fault status. You need to completely power off (off the screen) or wait for 30 minutes to restart the machine. The fault LCD display is shown in the figure above. In fault mode fault icon is bright, in alarm state alarm icon is flashing, and contact the manufacturer to troubleshoot the abnormal situation according to the fault information.

Fault: The inverter enters fault mode, with a constant red LED light and LCD displaying a fault code.

Fault code sheet


Fault code	Meaning	Relevant action	Trigger conditions	Resume conditions
1	Bus boost fail	Turn fault mode	Grid soft start process starts but bus voltage does not reach set value	Restore after reaching the set voltage for 15 seconds
2	Bus over voltage	Turn fault mode	Bus voltage is higher than set value	Restore after reaching the set voltage for 15 seconds
3	Bus below voltage	Turn fault mode	Bus voltage is lower than set value	Cannot restore

Fault code	Meaning	Relevant action	Trigger conditions	Resume conditions
4	Battery over current	Turn fault mode	Battery current is higher than set value	Cannot restore
5	System over temperature	Turn fault mode	PFC temperature is higher than set value or fan is not connected	Restore after temperature lower than set value and fan connected for 15 minutes
6	Battery over voltage	Turn fault mode	Battery voltage is higher than set value	Restore after reaching the set voltage for 15 seconds
7	Bus soft start failed	Turn fault mode	Battery soft start process starts but the bus voltage has not reached set value	Restore after reaching the set voltage for 15 seconds
8	Bus short circuit	Turn fault mode	Bus voltage is lower than set value	Cannot restore
9	Inverter soft start failed	Turn fault mode	Inverter soft start process starts but the inverter voltage has not reached set value	Restore after reaching the set voltage for 15 seconds
11	Inverter under voltage	Turn fault mode	The inverter voltage is lower than the set value in battery mode	Restore after reaching the set voltage for 15 seconds

Fault code	Meaning	Relevant action	Trigger conditions	Resume conditions
12	Inverter short circuit	Turn fault mode	Inverter voltage is less than the set value and current is higher than the set value	Restore after reaching the set value for 15 seconds
13	Inverter negative power	Turn fault mode	The inverter power is negative and exceeds the set value for a period of time	Restore after reaching the set value for 15 seconds
14	Over load	Turn fault mode	The load current is higher than the set value	Restore after reaching the set value for 15 seconds
17	Program updating	Turn fault mode	Inverter updating or OTA	Restore after updating
18	PV reverse connection	Turn fault mode	PV reverse connection	Restore after connecting correctly for 15 seconds
26	BMS fault	Turn fault mode	Error code in BMS message.	Restore after BMS fault resolved
29	Inverter load abnormal	Turn fault mode	Abnormal inverter load leads to abnormal voltage	Restore after voltage returning normal for 15 seconds

6. Alarm Reference Code

Alarm: the inverter does not enter the fault mode, LED red light flashing, LCD displays the Alarm code.

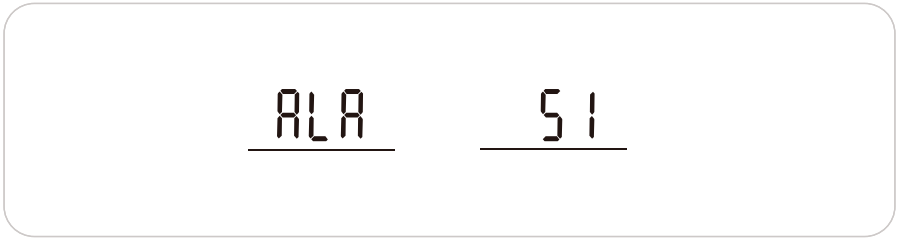

Alarm code sheet

Alarm code	Meaning	Relevant action	Trigger conditions	Resume conditions
50	Battery open	Alarm	Battery disconnected for no more than 10 minutes	Restore after battery connected and charging for 2 minutes
51	Battery under voltage	Alarm, battery low voltage shutdown or cannot power on	Battery voltage is lower than BAU set value	Restore after the battery voltage exceeding the BAU set value by 2V
52	Battery low voltage	Alarm	Battery voltage is lower than BAL set value	Restore after the battery voltage exceeding the BAL set value by 2V
53	Battery charge short circuit	Alarm, battery does not charge	Battery voltage is less than 12V and the charging current exists.	Restore after a maximum of 1 minute when the short circuit is eliminated.
56	BMS loss	Alarm	Communication failure after BMS communication function is enabled	Restore after communication function disabled or communication success
58	Fan error	Alarm, fan operation in full speed	No fan speed signal detected	Restore after fan speed signal detected

Alarm code	Meaning	Relevant action	Trigger conditions	Resume conditions
59	EEPROM error	Alarm	EEPROM read/write exception	Can not restore
60	Overload	Alarm	The grid current/battery discharge current/ load power is higher than the rated value.	Restore after the grid current/battery discharge current/load power is less than the rated value.
62	PV energy weak	Alarm, Turn off the PV output to the load, but keep the PV charging the battery	When the battery is not connected, the bus voltage is lower than the set value	Restore after battery connected or grid connected, or 10 minutes later.
68	Battery under SOC shutdown	Alarm, turn to standby mode	BMS reports SOC lower than BSU set value	Restore after meeting one of the following three conditions: 1. Disable low SOC shutdown function 2. Disable BMS communication function 3. SOC is higher than the set value by 5%
69	Battery below SOC warning	Alarm, if it is in standby mode, it will remain in standby mode.	Lithium battery SOC is lower than set value+5% (grid mode or battery mode), lower than set value+10% (standby mode)	Restore after meeting one of the following three conditions: 1. Disable low SOC shutdown function 2. Disable BMS communication function 3. SOC is higher than the set value by 10%
72	Battery can not startup	Alarm	During standby, battery voltage is lower than the allowed startup voltage	Restore after the battery voltage is higher than the allowed startup voltage
77	Grid power is unstable	Alarm	Lost of grid power three times within 5 minutes	Restore after 5 mins

7. Battery Equalization

Equalization function is added into charge controller. It reverses the buildup of negative chemical effects like stratification, a condition where acid concentration is greater at the bottom of the battery than at the top. Equalization also helps to remove sulfate crystals that might have built up on the plates. If left unchecked, this condition, called sulfation, will reduce the overall capacity of the battery. Therefore, it's recommended to equalize battery periodically.

Note:*Don't activate this mode when using lithium batteries.

- How to Apply Equalization Function

  You can enable battery equalization function in monitoring LCD setting Program 32 by setting time, or you can choose immediate equalization on Program 35. Then, you may apply this function in device by either one of following methods:

  1.Set equalization voltage point on Program 31.

  2.Set equalization charging time on Program 32.

  3.Set equalization delay time on Program 33.

  4.Set equalization interval time on Program 34.

  5.Set immediate equalization mode activation on Program 35.

8. Trouble Shooting

Problem	Fault Event	Trigger conditions	What to do
LED screen display fault code 5	Over temperature	1.PFC temperature exceeds the protection threshold for more than 20 seconds. 2.Alarm58 lasts for 5 seconds.	Please check if the fan is not connected or if there are loose wiring issues. If the fan is not connected for more than 5 minutes, the machine will report fault code 5.
LED screen display fault code 12	Inverter short circuit	In battery mode or standby mode, if the inverter voltage is lower than 80V and the inverter current is greater than 30A, it should respond within 100-120ms.	1.Check if there is a short circuit at the output terminals (such as a screw piercing through the locking terminal causing a LN short circuit). 2.Verify if the inverter voltage and inverter current meet the triggering conditions.
LED screen display fault code 58	Fan malfunction	Any of the fans rotating less than 8 times within 2 seconds.	1.Check if the fan is not connected properly or if there are any loose connections. 2.If the fan is properly connected: a) Check if there is any issue with the fan detection circuit, usually caused by excessive soldering underneath the control board socket. b) Check if the fan itself is damaged.
Unable to start	Battery	Due to the need for a voltage of ≥11.5V/N to start the machine in battery mode, common reasons for failure to start include improper calibration or insufficient battery voltage.	1.Check if the battery voltage sampling is functioning properly and if the battery voltage has been calibrated. 2.Use a multimeter to measure the voltage at the battery terminals (using a DC power supply or a real battery) to see if it reaches the minimum voltage of 11.5V per cell for startup. Note: It is crucial to configure the battery voltage according to the machine model. Connecting the wrong battery voltage can cause capacitor explosion.

Unable to start	Utility power		1.Check for any short circuits at the grid terminal (such as a screw piercing through and causing a short circuit between the live and neutral terminals). 2.Check if there are any wiring errors, such as mistakenly connecting the grid input to the output terminals.
	PV		1.Check if the PV input voltage is too close to the critical threshold. 2.For low voltage versions of the machine, check if the software version numbers of the main control is compatible. If the software versions differ significantly, the machine may not be activated.
PV not charging			Connecting the wrong battery voltage can result in damage to the auxiliary power supply on the PV side, causing a loss of power and inability to communicate with the main control.

Notes: Updates to the content and version of this manual will not be notified separately.

9 . Specifications

AC Input	
Rated Input Voltage (VAC)	208/220/230/240; L+N+PE
Voltage Range (VAC)	90~280 (APP/GEN mode); 170~264 (UPS mode)
Frequency (Hz)	50/60 (Auto Adaptive)
AC Output	
Rated Capacity (kVA/kW)	5 (Output Power rating will be reduced to 90%, when setting the Output Voltage to 208V)
Surge Power (kVA)	10
Voltage (VAC)	208/220/230/240
Power Factor (PF)	1
Frequency (Hz)	50/60±0.1%
Switch Time (ms)	10 (APP/UPS mode) / 20 (GEN mode)
WaveForm	Pure SineWave
Overload Capacity (Battery Mode)	1min@102%~120% load, 10s@ 120%~200% load
Max. Efficiency (Battery Mode)	93.5%@24V
Charger(PV/AC)	
Solar Charger Type	MPPT
Max PV Input Current (A)/Power (W)	27/9000
MPPT Range@Operating Voltage (VDC)	60~450
PV Start-up Voltage (VDC)	80
Max PV Open Circuit Voltage (VDC)	500
Max PV Charge Current (A)	160
Max AC Charge Current (A)	160
Max. Charge Current (PV+AC) (A)	160
Battery	
Normal Voltage (VDC)	24
Battery Type	Lithium/Lead-acid
General Data	
HMI	LCD
Interface	RS485/CAN/RS232
Monitoring	WiFi(Optional)
General Data	
Ingress Protection	IP21
Operating Temperature (℃)	-10~60
Relative Humidity	5%~95% (Non-condensing)
Storage Temperature (℃)	-15~60
Max. Operating Altitude (m)	4000 (Derating above 2000)

Maximum Load Capacity

Only Battery	4000W@25V
PV+Battery	5000W
Bypass current	40A@25℃

